

# GEIST™ SWITCHAIR

## AIRFLOW MANAGEMENT DEVICE

### Quick Installation Guide



#### Models:

SA1-01002, SA1-01002S and SA1-01002L

#### Type:

Rear Air Intake-Front (Port)  
Exhaust Switches

**CAUTION:** Ensure the required airflow for safe operation of equipment is not compromised when installing the Geist SwitchAir.

**WARNING:** Take precaution to avoid interference with the switch input power cords when installing on a live unit.

#### 1. Preparing for installation

Before installing the SwitchAir, remove the lower screw that attaches each of the two switch mounting bracket rails (left and right) to the front rack uprights (if necessary). Save these screws to be used in the next step. The switch mounting bracket rails' upper screws remain fastened.

SwitchAir is not in the fully extended position when shipped from the factory. Pull evenly on the chassis mounting tabs for the desired depth.

#### 2. Installing the unit into the rack


Insert SwitchAir into the open rack space at the same U height as the switch. As the SwitchAir is pushed into the space, the SwitchAir rail tabs will engage the switch mounting bracket rails for support during installation. Keep pushing the SwitchAir into the space until the SwitchAir front chassis mounting tabs are flush with the rack's front rails.

Reinstall the screws that were removed previously. Installation is complete.

Geist SwitchAir Airflow Management Device



Geist SwitchAir Rack Installation

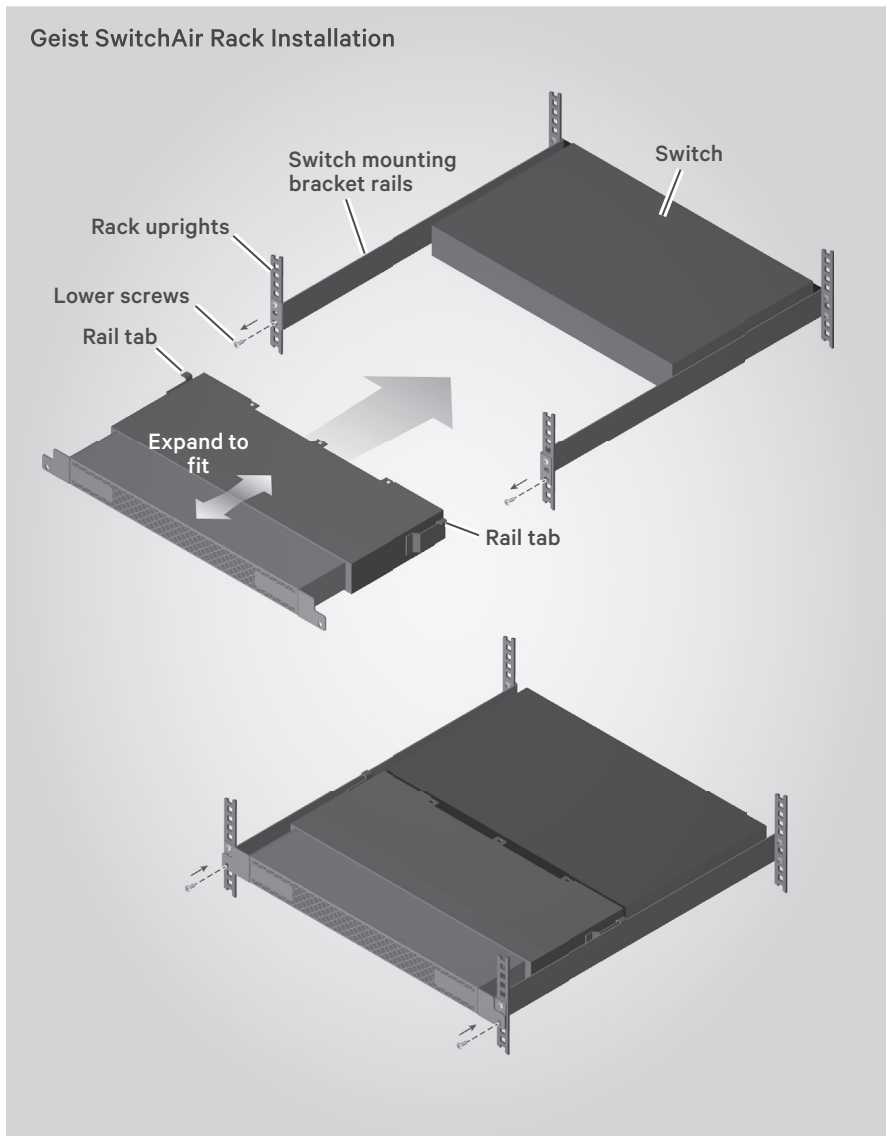



**To contact Vertiv Technical Support: visit [www.VertivCo.com](http://www.VertivCo.com)**

© 2019 Vertiv Co. All rights reserved. Vertiv and the Vertiv logo are trademarks or registered trademarks of Vertiv Co. All other names and logos referred to are trade names, trademarks or registered trademarks of their respective owners. While every precaution has been taken to ensure accuracy and completeness herein, Vertiv Co. assumes no responsibility, and disclaims all liability, for damages resulting from use of this information or for any errors or omissions. Specifications are subject to change without notice.

